

## SHENZHEN FUDIANKANG ENERGY CO., LTD

Tel:86-13729889887 Fax:86-20-84550026

Web: www.fdkenergy.com Email: info@fdkenergy.com

## **DATA SHEET**

**DIESEL GENERATOR 1320KW** MODEL#FDK-CC1320/H1 50HZ/1500RPM

**CUMMINS MODEL: KTA50-G8** 



#### **General Features:**

- All qualified generator sets are subjected to a comprehensive performance test which includes 50% load, 70% load, 100% load, 110% load and to check, verify that all control systems, alarm and shut-down protection.
- Equipped with battery charger and 24V high performance maintenance-free lead-acid starting batteries and connecting
- Stainless galvanized zinc plates with strong corrosion-proof.
- Vibration isolators between the engine/alternator and base frame.
- Equipped with industrial silencer and flexible exhaust hose.
- Designed to comply with ISO8528/GB2820.
- Powered by Cummins engine and coupled with Stamford alternator.
- Water jacket preheater, oil heater and double air cleaner, etc. are available.

#### **FDK Diesel Generator Set Data**

Genset Model	FDK-CC1320/H1
Prime Power	1200KW/1500KVA
Standby Power	1320KW/1650KVA
Output Frequency / Rated speed	50Hz/1500rpm
Rated Voltage	230V/400V

Engine Make	Cummins
Engine Model	KTA50-G8
Alternator model	Stamford PI734C
Control System	DSE7320
Phase	Three

- (1) Prime power: The rating is available for an unlimited of annual operating hours in variable load applications, in accordance with ISO8528-1.A 10% overload is available for a period of 1 hour within 12-hour period of operation, in accordance with ISO 3046-1.
- (2) Standby power: The rating is applicable for supplying emergency power in variable load applications for up to 200 hours per year in accordance with ISO8528-1. Overload is not allowed.
- (3) Rated voltage: available with customer requirement.

#### **Engine Specifications** (DETAILED in APPENDIX)

Engine Model	KTA50-G8
Engine Manufacturer	Cummins
	CHINA CCEC
Cylinder quantity	16
Cylinder Arrangement	60° Vee
Cycle	4

Aspiration	Turbo-charged
Bore x Stroke (mm x mm)	159×159
Displacement	50.3L
Compression Ratio	14.9:1
Prime power / Speed (KW/RPM)	1200kw/1500
Standby power/ Speed (KW/RPM)	1429kw/1500





FDK reserves the right to change the specifications and designs without noice.



## SHENZHEN FUDIANKANG ENERGY CO., LTD

Tel:86-13729889887 Fax:86-20-84550026

Web: www.fdkenergy.com	Email: info@fdkenergy.com
------------------------	---------------------------

Type Injection System	Cummins PT	Fuel Consumption at 100% load	205 at 1500rpm
	Direct Injection	(g/KWh)	
Piston Speed	7.9m/s	Starter motor	DC24V
Friction Energy Output	116kw	Low idle	725-775pm
Total Lubrication System Capacity	204L	Coolant Capacity (L)	140

#### **Alternator Specifications**

Alternator model	PI734C	Number of phase	3
Alternator manufacturer	STAMFORD	Rated voltage	400V (Available with
Exciter type	Single bearing, Brushless,		custom requirements)
	Self-excited	Power factor	0.8
Rated output prime power	1550KVA	Voltage regulation NL-FL	≤±1%
Rated speed	1500 rpm	Insulation grade	Н
Rated frequency	50Hz	Protection grade	IP23

Alternator option: Leroy Somer, MECC, Marathon, Engga, Faraday

#### Control System DSE7320 (DETAILED in INSTRUCTION)

DSE7320 is an advanced control module based on micro-processor, containing all necessary functions for protection of the genset and the breaker control. It can monitor the mains supply, breaker control and automatically start the engine when the mains are abnormal. Accurately measure various operational parameters and display all values and alarms information on the LCD. In addition, the control module can automatically shut down the engine and indicate the engine failure.

#### **FEATURES**

- Microprocessor control, with high stability and credibility.
- Monitoring and measuring operational parameters of the mains supply and genset.
- Indicating operation status, fault conditions, all parameters and alarms.
- Multiple protections; multiple parameters display, like pressure, temp. etc.
- Manual, automatic and remote work mode selectable.
- Real time clock for time and date display, overall runtime display, 250 log entries.
- Overall power output display.
- Integral speed/frequency detecting, telling status of start, rated operation, overspeed etc.
- Communication with PC via RS485 OR RS232 interface, using MODBUS protocol.

#### **Soundproof Enclosure Specification**

FDK silent generator is designed by professional acoustic engineers based on years of experience. Now we can make the noise of the generator less than 80-85dB(A) at 1m, or 70-75dB(A) at 7m, 60-65dB(A) at 15m.

#### **FEATURES**

- Multi-way air intake and exhaust guarantee the power performance of the generator.
- Large-scale impedance combined type silencer effectively reduce noise of the generator.
- Internal high performance rubber damper and flexible materials reduce vibration.
- Base mounted fuel tank supports the generator running for 8 hours.





FDK reserves the right to change the specifications and designs without noice.



## SHENZHEN FUDIANKANG ENERGY CO., LTD

Tel:86-13729889887 Fax:86-20-84550026

Web: www.fdkenergy.com Email: info@fdkenergy.com

#### **Optional**

Gen	erator set	Alte	rnator	Low environment Temp		ATS	
	Open generator set		Stamford		Water heater		CHINT
	Silent generator set		Marathon		Oil heater		SCHNEIDER
	Trailer generator set		Mecc Alte		Battery heater		ABB
	ABB MCCB circuit breaker		Leroy Somer				
			Farady				
			Engga				
Fue	system	Control system		Voltage		Syn	chronized system
	12hrs base tank		AMF function		415/240V		CHINT Cabinet
	24hrs base tank		ATS control cabinet		400/230V		SCHNEIDER Cabinet
	Dual wall base fuel tank		DSE7320		380/220V		DSE8610 Module
	Outside fuel tank		DSE7510		220/127V		COMAQ Module
			GU620A		200/115V	П	DEIF Module

### **Dimension & Weight** Open

Overall Size:	5100×2255×2565
L×W×H (mm)	
Weight (kg)	11400

### **Soundproof Version**

Overall Size:	40FT CONTAINER
LxWxH (mm)	
Weight (kg)	25000

#### **Sales Promises**

- FDK provides a full line of brand new and high quality products. Each and every unit is strictly factory tested before
- Quality warranty is according to our standard conditions: 12 months from BL date or 1000 running hours, whichever comes
- Service and parts are available from FDK or distributors in your location.
- FDK guarantee use BRAND NEW & GENUINE MACHINE.







#### **CUMMINS ENGINE COMPANY, INC**

Columbus, Indiana 47201

#### **ENGINE PERFORMANCE CURVE**

Basic Engine Model: **KTA50-G8** 

Engine Critical Parts List:

CPL: 2354 (1 Pump / 2 Loop)

CPL: 2859 (2 Pump / 2 Loop)

Curve Number: FR-6243 (1P / 2L) FR-6351 (2P / 2L)

/ 2L)

Page

Nο

Date:

5Mar04


Displacement : **50.3** litre (**3067** in<sup>3</sup> ) Bore : **159** mm (**6.25** in.) Stroke : **159** mm (**6.25** in.)

No. of Cylinders: 16 Aspiration: Turbocharged and Low Temperature Aftercooled

Engine Speed	Standb	y Power	Prime	Power	Continuo	us Power
RPM	kWm	ВНР	kWm BHP		kWm	ВНР
1500	1429	1915	1200	1608	1100	1475

### **Engine Performance Data @ 1500 RPM**

OUTI	OUTPUT POWER			FUEL CONSUMPTION				
%	kWm	ВНР	kg/ lb/ litre/ kWm·h BHP·h hour			U.S. Gal/ hour		
STAN	DBY PO	WER						
100	1429	1915	0.206	0.338	345	91.2		
PRIME	POWE	R						
100	1200	1608	0.205	0.337	289	76.3		
75	900	1206	0.210	0.346	222	58.7		
50	600	804	0.220	0.362	155	40.9		
25	300	402	0.233	0.383	82	21.7		
CONT	CONTINUOUS POWER							
100	1100	1475	0.206	0.339	266	70.4		

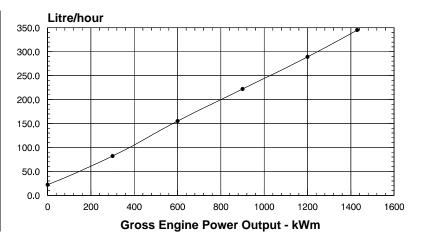

These guidelines have been formulated to ensure proper application of generator drive engines in A.C. generator set installations. Generator drive engines are not designed for and shall not be used in variable speed D.C. generator set applications.

#### STANDBY POWER RATING

Applicable for supplying emergency power for the duration of the utility power outage. No overload capability is available for this rating. Under no condition is an engine allowed to operate in parallel with the public utility at the Standby Power rating. This rating should be applied where reliable utility power is available. A Standby rated engine should be sized for a maximum of an 80% average load factor and 200 hours of operation per year. This includes less than 25 hours per year at the Standby Power rating. Standby ratings should never be applied except in true emergency power outages. Negotiated power outages contracted with a utility company are not considered an emergency.

#### PRIME POWER RATING

Applicable for supplying electric power in lieu of commercially purchased power. Prime Power applications must be in the form of one of the following two categories:

#### **UNLIMITED TIME RUNNING PRIME POWER**

Prime Power is available for an unlimited number of hours per year in a variable load application. Variable load should not exceed a 70% average of the Prime Power rating during any operating period of 250 hours. The total operating time at 100% Prime Power shall not exceed 500 hours per year. A 10% overload capability is available for a period of 1 hour within a 12-hour period of operation. Total operating time at the 10% overload power shall not exceed 25 hours per year.

#### LIMITED TIME RUNNING PRIME POWER

Limited Time Prime Power is available for a limited number of hours in a non-variable load application. It is intended for use in situations where power outages are contracted, such as in utility power curtailment. Engines may be operated in parallel to the public utility up to 750 hours per year at power levels never to exceed the Prime Power rating. The customer should be aware, however, that the life of any engine will be reduced by this constant high load operation. Any operation exceeding 750 hours per year at the Prime Power rating should use the Continuous Power rating.

#### CONTINUOUS POWER RATING

Applicable for supplying utility power at a constant 100% load for an unlimited number of hours per year. No overload capability is available for this rating.

**CONVERSIONS:** (Litres = U.S. Gal x 3.785)

 $(kWm = BHP \times 0.746)$ 

(U.S. Gal = Litres x 0.2642)

(BHP = Engine kWm x 1.34)


Data shown above represent gross engine performance capabilities obtained and corrected in accordance with ISO-3046 conditions of 100 kPa (29.53 in Hg) barometric pressure [110 m (361 ft) altitude], 25 °C (77 °F) air inlet temperature, and relative humidity of 30% with No. 2 diesel or a fuel corresponding to ASTM D2. See reverse side for application rating guidelines.


The fuel consumption data is based on No. 2 diesel fuel weight at 0.85 kg/litre (7.1 lbs/U.S. gal).

Power output curves are based on the engine operating with fuel system, water pump and lubricating oil pump; not included are battery charging alternator, fan, optional equipment and driven components.

### KTA50-G8 Derate Curves @ 1500 RPM

CURVE NO: FR-6243 DATE: 5Mar04

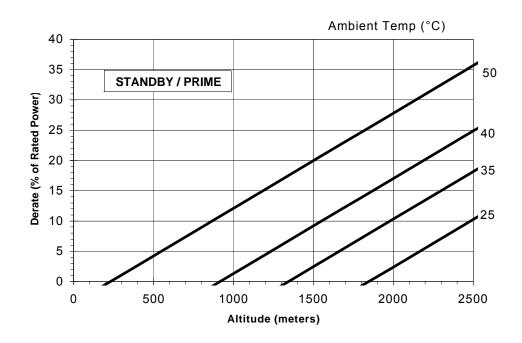

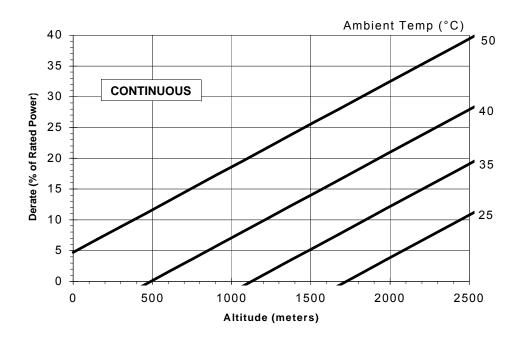

#### Reference Standards:

BS-5514 and DIN-6271 standards are based on ISO-3046.

#### Operation At Elevated Temperature And Altitude:

For sustained operation above these conditions, derate by an additional 4.6% per 300m (1000ft) and 12% per  $10^{\circ}C$  ( $18^{\circ}F$ )

NOTE: Derates shown are based on  $15^{\circ}H_20$  air intake restriction and  $2^{\circ}H_20$  exhaust back pressure.

# Cummins Engine Company, Inc. Engine Data Sheet

DATA SHEET: DS-6243 **ENGINE MODEL: KTA50-G8 CONFIGURATION NUMBER:** D283022DX02

DATE: 5Mar04
PERFORMANCE CURVE: FR-6243 (1P / 2L)

FR-6351 (2P / 2L)

**INSTALLATION DIAGRAM** 

• Fan to Flywheel (1P / 2L): 3170289 • Fan to Flywheel (2P / 2L): 3626419

**CPL NUMBER** Engine Critical Parts List
 Engine Critical Parts List

: 2354 : 2859

Туре		4-Cycle; 60° Vee		
Aspiration		Turbocharged &	•	cooled
Bore x Stroke	` _ /	6.25 x 6.25 (159)	x 159)	
Displacement	— in <sup>3</sup> (liter)	3067 (50.3)		
Compression Ratio		14.9 : 1		
Dry Weight				
Fan to Flywheel Engine	— lb (kg)	11820	(5360)	
Wet Weight				
Fan to Flywheel Engine	— lb (kg)	12485	(5662)	
Moment of Inertia of Rotating Components	2 2			
with FW 6009 Flywheel		301	(12.7)	
with FW 6017 Flywheel		515	(21.7)	
Center of Gravity from Rear Face of Flywheel Housing (FH 6024)		47.5	(1206)	
Center of Gravity Above Crankshaft Centerline	, ,	11.0	(279)	
Maximum Static Loading at Rear Main Bearing	— lb (kg)	2000	(908)	
NGINE MOUNTING				
Maximum Bending Moment at Rear Face of Block	— lb • ft (N • m)	4500	(6100)	
KHAUST SYSTEM				
Maximum Back Pressure @ Standby Power Rating	— in Ha (mm Ha)	2	(51)	
R INDUCTION SYSTEM	3 ( 3)		(- /	
Maximum Intake Air Restriction				
with Dirty Filter Element @ Standby Power Rating	in H <sub>2</sub> O (mm H <sub>2</sub> O)	25	(635)	
with Clean Filter Element @ Standby Power Rating		15	(381)	
OOLING SYSTEM (Low Temperature Aftercooling Required; 1 Pun			(501)	
			(440)	
Coolant Capacity — Engine Only		37	(140)	
— Aftercoolers		9	(34)	
Maximum Static Head of Coolant Above Engine Crank Centerline	` '	190 200	(18.3)	
Thermostat Modulating Range — High Flow (Jacket)		180 - 200	(82 - 93)	
Maximum Top Tank Temperature for Standby Power / Prime Power		220 / 212	(104 / 100)	
Target Coolant Inlet Temperature to Aftercoolers @ 77 °F (25 °C) Ambient—		130	(55)	
Maximum Coolant Temperature to Aftercoolers; Standby Power / Prime Power	– F(C)	160 / 150	(71 / 66)	
Additional 2 Pump / 2 Loop Requirements  Maximum Coolant Friction Lload Faterral to Facine Lligh Flour / locket)	nai (kDa)	10	(67)	
Maximum Coolant Friction Head External to Engine — High Flow (Jacket)		10	(67)	
— Low Flow (Aftercooler)		5 05 105	(35)	
Thermostat Modulating Range — Low Flow (Aftercooler) (2P / 2L) w		95 - 105	(35 - 40)	
Minimum Pressure Cap (for Cooling Systems with less than 2 m [6 ft.] Stati	ic nead) — psi (kPa)	10	(67)	
Additional 1 Pump / 2 Loop Requirements  Maximum Coolant Friction Lload Fixtornal to France Lligh Flour ( look at )	nai (kDa)	10	(70)	
Maximum Coolant Friction Head External to Engine— High Flow (Jacket)		10	(70)	
— Low Flow (Aftercooler)		5 150 175	(35)	
Thermostat Modulating Range — Low Flow (Aftercooler)		150 - 175	(66 - 79)	
Minimum Pressure Cap (for Cooling Systems with less than 2 m [6 ft.] Stati JBRICATION SYSTEM	ic nead) — psi (kra)	14	(96)	
Oil Pressure @ Idle Speed	— psi (kPa)	20	(138)	
@ Governed Speed		50 - 70	(345 - 483)	
Maximum Oil Temperature		250	(121)	
Oil Capacity with OP 6027 Oil Pan : High - Low	` '	47 - 39	(178 - 148)	
Total System Capacity (Including Bypass Filter)		54	(204)	
JEL SYSTEM			, ,	
Type Injection System			•	
Maximum Restriction at PT Fuel Injection Pump — with Clean Fuel Filter			4.0	(10
— with Dirty Fuel Filter			8.0	(20
Maximum Allowable Head on Injector Return Line (Consisting of Friction Head Maximum Fuel Flow to Injection Pump	and Static Head)	— in Ha (mm Ha)	6.5	(16

#### **ELECTRICAL SYSTEM**

Cranking Motor (Heavy Duty, Positive Engagement)	24	
Battery Charging System, Negative Ground — ampere	35	
Maximum Allowable Resistance of Cranking Circuit	0.002	
Minimum Recommended Battery Capacity		
• Cold Soak @ 50 °F (10 °C) and Above	1280	
• Cold Soak @ 32 °F to 50 °F (0 °C to 10 °C)	1800	
• Cold Soak @ 0 °F to 32 °F (-18 °C to 0 °C)	1800	
COLD START CAPABILITY		
Minimum Ambient Temperature for Aided (with Coolant Heater) Cold Start within 10 seconds	50	(10)
Minimum Ambient Temperature for Unaided Cold Start	45	(7)

#### **PERFORMANCE DATA**

All data is based on:

- Engine operating with fuel system, water pump, lubricating oil pump, air cleaner and exhaust silencer; not included are battery charging alternator, fan, and optional driven components.
- Engine operating with fuel corresponding to grade No. 2-D per ASTM D975.

• ISO 3046, Part 1, Standard Reference Conditions of:

Barometric Pressure : 100 kPa (29.53 in Hg) Air Temperature : 25 °C (77 °F)

Altitude : 110 m (361 ft) Relative Humidity : 30%

Steady State Stability Band at any Constant Load	+/- 0.25
Estimated Free Field Sound Pressure Level of a Typical Generator Set;	
Excludes Exhaust Noise; at Rated Load and 7.5 m (24.6 ft); 1500 rpm	92.4
Exhaust Noise at 1 m Horizontally from Centerline of Exhaust Pipe Outlet Upwards at 45°	N.A.

Governed Engine Speed	— rpm
Engine Idle Speed	
Gross Engine Power Output	— BHP (kW <sub>m</sub> )
Brake Mean Effective Pressure	psi (kPa)
Piston Speed	— ft / min (m / s)
Friction Horsepower	— HP (kW <sub>m</sub> )
Engine Data with Dry Type Exhaust Mar	<u>nifold</u>
Intake Air Flow	
Exhaust Gas Temperature	°F (°C)
Exhaust Gas Flow	— cfm (liter / s)
Air to Fuel Ratio	
Radiated Heat to Ambient	
Heat Rejection to Exhaust	— BTU / min (kW <sub>m</sub> )
Additional Engine Aftercooler Data (2 P	<u>ump / 2 Loop)</u>
Engine Jacket Coolant Flow at Stated Friction F	lead External to Engine:
4 psi Friction Head	— US gpm (liter / s)
Maximum Friction Head	01 ( /
Heat Rejection to Coolant (Aftercooler)	— BTU / min (kW <sub>m</sub> )
Heat Rejection to Coolant (Engine)	
Aftercooler Coolant Flow at Stated Friction Head	
2 psi Friction Head	
Maximum Friction Head	
Additional Engine Aftercooler Data (1 P	
Engine Jacket Coolant Flow at Stated Friction F	
4 psi Friction Head	•· · · · ·
Maximum Friction Head	0. ( ,
Heat to be Rejected by Low Temperature Radi	
Heat to be Rejected by Jacket Water Radiator*	· · · · · · · · · · · · · · · · · · ·
Aftercooler Coolant Flow at Stated Friction Head	_
• 2 psi Friction Head	01 ( ,
Maximum Friction Head	— US gpm (liter / s)

STANDBY POWER			PRIME POWER		
60 hz	50 hz		60 hz	50 hz	
	1500			1500	
	_	- 775		_	- 775
	1915	(1429)		1608	(1200)
	330	(2275)		277	(1910)
	1562	(7.9)		1562	(7.9)
	155	(116)		155	(116)
	3500	(1655)		3180	(1500)
	950	(510)		900	(485)
	9210	(4350)		8150	(3845)
	23.2			25.1 : 1	
	12000	(210)		9900	(175)
	54200	(954)		45270	(800)
Not	440	(27.8)	Not	440	(27.8)
Applicable for	400	(25.2)	Applicable for	400	(25.2)
1800 RPM	15600	(275)	1800 RPM	11000	(195)
Operation	35000	(615)	Operation	30950	(545)
		(2.2)			(2.2)
	100	(6.3)		100	(6.3)
	95	(6.0)		95	(6.0)
	352	(22.2)		352	(22.2)
	320	(20.2)		320	(20.2)
	30400	(535)		30660	(540)
	22030	(390)		11550	(205)
	85	(5.4)		85	(5.4)
	80	(5.0)		80	(5.0)
		` ,			. ,

N.A. - Data is Not Available

N/A - Not Applicable to this Engine

TBD - To Be Determined

ENGINE MODEL: KTA50-G8
DATA SHEET: DS-6243
DATE: 5Mar04

CURVE NO : FR-6243 (1P / 2L) www.fdkenerepy-6351 (2P / 2L)

<sup>\*</sup> See AEB 90.39 1 Pump / 2 Loop KTA50-G8/9 system.