


# GUANGDONG FUDIANKANG DIESEL GENSET CO., LTD SHENZHEN FUDIANKANG DIESEL GENESET CO., LTD

Tel: 86-13710087995 Email: info@fdkenergy.com

Web: www.fdkenergy.com

# **DATA SHEET**

DIESEL GENERATOR 1100KW *MODEL#FDK-CC1375/H1* 50HZ/1500RPM CUMMINS MODEL: QSK38-G5

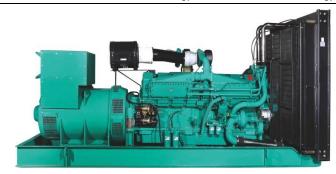

### **General Features:**

- All qualified generator sets are subjected to a comprehensive performance test which includes 50% load, 70% load, 100% load, 110% load and to check, verify that all control systems, alarm and shut-down protection.
- Equipped with battery charger and 24V high performance maintenance-free lead-acid starting batteries and connecting cables
- Stainless galvanized zinc plates with strong corrosion-proof.
- Vibration isolators between the engine/alternator and base frame.
- Equipped with industrial silencer and flexible exhaust hose.
- Designed to comply with ISO8528/GB2820.
- Powered by Cummins engine and coupled with Stamford alternator.
- Water jacket preheater, oil heater and double air cleaner, etc. are available.

#### **FDK Diesel Generator Set Data**

Genset Model	FDK-CC1375/H1
Prime Power	1000KW/1250KVA
Standby Power	1100KW/1375KVA
Output Frequency / Rated speed	50Hz/1500rpm
Rated Voltage	230V/400V

Engine Make	Cummins CHINA
Engine Model	QSK38-G5
Alternator model	Stamford LVI634G
Control System	DSE7320
Phase	Three

- (1) **Prime power**: The rating is available for an unlimited of annual operating hours in variable load applications, in accordance with ISO8528-1.A 10% overload is available for a period of 1 hour within 12-hour period of operation, in accordance with ISO 3046-1.
- (2) **Standby power**: The rating is applicable for supplying emergency power in variable load applications for up to 200 hours per year in accordance with ISO8528-1. Overload is not allowed.
- (3) Rated voltage: available with customer requirement.

# Engine Specifications (DETAILED in APPENDIX)

Engine Model	QSK38-G5		
Engine Manufacturer	Cummins		
	CHINA CCEC		
Cylinder quantity	16		
Cylinder Arrangement	60° Vee		
Cycle	4		

Aspiration	Turbo-charged
Bore x Stroke (mm x mm)	159×159
Displacement	37.7L
Compression Ratio	15:1
Prime power / Speed (KW/RPM)	1107kw/1500
Standby power/ Speed (KW/RPM)	1224kw/1500







# GUANGDONG FUDIANKANG DIESEL GENSET CO., LTD SHENZHEN FUDIANKANG DIESEL GENESET CO., LTD

Tel: 86-13710087995

		Web: www.fdkenergy.com E	mail: info@fdkenergy.com
Type Injection System	Cummins	Fuel Consumption at 100% load	211 at 1500rpm
	MCRS	(g/KWh)	
Piston Speed	7.9m/s	Starter motor	DC24V
Friction Energy Output	86kw	Low idle	700-900pm
Total Lubrication System Capacity	170.3L	Coolant Capacity (L)	106

## **Alternator Specifications**

Alternator model	LVI634G	Number of phase	3
Alternator manufacturer	STAMFORD	Rated voltage	400V (Available with
Exciter type	Single bearing, Brushless,		custom requirements)
	Self-excited	Power factor	0.8
Rated output prime power	1250KVA	Voltage regulation NL-FL	≤±1%
Rated speed	1500 rpm	Insulation grade	Н
Rated frequency	50Hz	Protection grade	IP23

Alternator option: Leroy Somer, MECC, Marathon, Engga, Faraday

# Control System DSE7320 (DETAILED in INSTRUCTION)

DSE7320 is an advanced control module based on micro-processor, containing all necessary functions for protection of the genset and the breaker control. It can monitor the mains supply, breaker control and automatically start the engine when the mains are abnormal. Accurately measure various operational parameters and display all values and alarms information on the LCD. In addition, the control module can automatically shut down the engine and indicate the engine failure.

# **FEATURES**

- Microprocessor control, with high stability and credibility.
- Monitoring and measuring operational parameters of the mains supply and genset.
- Indicating operation status, fault conditions, all parameters and alarms.
- Multiple protections; multiple parameters display, like pressure, temp. etc.
- Manual, automatic and remote work mode selectable.
- Real time clock for time and date display, overall runtime display, 250 log entries.
- Overall power output display.
- Integral speed/frequency detecting, telling status of start, rated operation, overspeed etc.
- Communication with PC via RS485 OR RS232 interface, using MODBUS protocol.

#### **Soundproof Enclosure Specification**

FDK silent generator is designed by professional acoustic engineers based on years of experience. Now we can make the noise of the generator less than 80-85dB(A) at 1m, or 70-75dB(A) at 7m, 60-65dB(A) at 15m.

#### **FEATURES**

- Multi-way air intake and exhaust guarantee the power performance of the generator.
- Large-scale impedance combined type silencer effectively reduce noise of the generator.
- Internal high performance rubber damper and flexible materials reduce vibration.
- Base mounted fuel tank supports the generator running for 8 hours.







# GUANGDONG FUDIANKANG DIESEL GENSET CO., LTD SHENZHEN FUDIANKANG DIESEL GENESET CO., LTD

Tel: 86-13710087995

Web: www.fdkenergy.com Email: info@fdkenergy.com

# **Optional**

Generator set		Alte	rnator	Low	environment Temp	ATS	
	Open generator set		Stamford		Water heater		CHINT
	Silent generator set		Marathon		Oil heater		SCHNEIDER
	Trailer generator set		Mecc Alte		Battery heater		ABB
	ABB MCCB circuit breaker		Leroy Somer				
		□ Farady					
			Engga				
Fuel	system	Control system		Voltage		Synchronized system	
	12hrs base tank		AMF function		415/240V		CHINT Cabinet
	24hrs base tank		ATS control cabinet		400/230V		SCHNEIDER Cabinet
	Dual wall base fuel tank		DSE7320		380/220V		DSE8610 Module
	Outside fuel tank		DSE7510		220/127V		COMAQ Module
			GU620A		200/115V		DEIF Module

# Dimension & Weight Open

Overall Size:	4900×2150×2450
L×W×H (mm)	
Weight (kg)	10300

# **Soundproof Version**

Overall Size:	40FT CONTAINER
L×W×H (mm)	
Weight (kg)	22000

### **Sales Promises**

- ◆ FDK provides a full line of brand new and high quality products. Each and every unit is strictly factory tested before shipment.
- Quality warranty is according to our standard conditions: 12 months from BL date or 1000 running hours, whichever comes
- ♦ Service and parts are available from FDK or distributors in your location.
- ◆ FDK guarantee use BRAND NEW & GENUINE MACHINE.





# **Engine Performance Data Cummins Inc**

Columbus, Indiana 47202-3005 http://www.cummins.com

**Power Generation** 

**QSK38-G5** 

FR 6699

Configuration D233042GX03 CPL Code 3267

Revision 29-May-2009

Compression Ratio: 15:1

Fuel System: **Cummins MCRS** 

Displacement: Aspiration:

2,301 in3 (37.7 L)

**Turbocharged and Aftercooled** 

**Engine Ratings:** 


U.S. EPA Tier 2, CARB Tier 2 (without Centinel)

**Emission Certification:** 

Engine Speed	Standb	Standby Power Prime Power Continuous Po		Prime Power		us Power
RPM	bhp	kWm	bhp	kWm	bhp	kWm
1,500	1,641	1,224	1,484	1,107	1,250	932
1,800	1,715	1,279	1,425	1,063	1,195	891


### **Engine Fuel Consumption @1,500 RPM**

Output Power			Fu						
% bhp kWm		lb/ bhp-h	kg/ kWm-h	gal/hr	l/hr				
Standby Power									
100	1,641	1,224	0.343	0.209	79.4	301			
Prime	Power								
100	1,484	1,107	0.347	0.211	72.5	274			
75	1,113	830	0.348	0.212	54.5	206			
50	742	553	0.391	0.238	40.8	154			
25	371	277	0.407	0.248	21.3	81			
Continuous Power									
100	1,250	932	0.345	0.210	60.8	230			

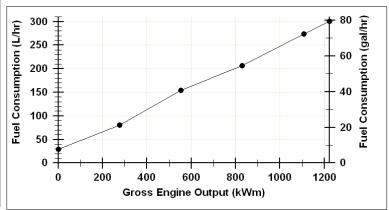

# Engine Fuel Consumption @1,800 RPM

Out	tput Pov	ver	Fuel Consumption							
%	bhp kWm		lb/ bhp-h	1,		l/hr				
Standb	Standby Power									
100	1,715	1,279	0.345	0.210	83.3	315				
Prime I	Power									
100	1,425	1,063	0.345	0.210	69.3	262				
75	1,069	797	0.355	0.216	53.4	202				
50	713	532	0.402	0.245	40.3	153				
25	356	265	0.473	0.288	23.7	90				
Contin	Continuous Power									
100	1,195	891	0.351	0.214	59	223				

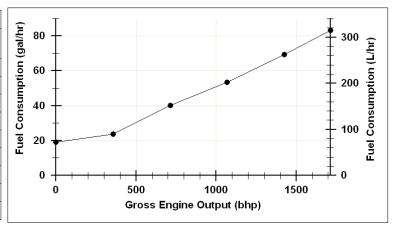

### Rating Type:

These guidelines have been formulated to ensure proper application of generator drive engines in A.C. generator set installations. STANDBY POWER RATING; Applicable for supplying emergency power for the duration of the utility power outage. No overload capability is available for this rating. Under no condition is an engine allowed to operate in parallel with the public utility at the Standby Power rating. This rating should be applied where reliable utility power is available. A Standby rated engine should be sized for a maximum of an 90% average load for an 200 hours of operation per year. This includes less than 25 hours per year at the Standby Power rating, Standby ratings should never be applied except in true emergency power outages. Negotiated power outages contracted with a utility company are not considered an emergency. PRIME POWER.

RATING: Applicable for supplying electric power in lieu of commercially purchased power. Prime Power applications must be in the form of one of the following two categories: UNI.IMITED ITIME RUNNING PRIME POWER.

Prime Power as available for an unfainted number of hours are variable load application. Variable load application. Variable load should not exceed a 70% average of the Prime Power rating unique any operating period of 250 hours. The total operating time at 100% Prime Power shall not exceed 350 hours per year. In 150 coverions are prime Power shall not exceed 350 hours per year. In 150 coverions are prime Power in available for a period of 1 hour within a 12-hour period of operation. Total operating time at 100% Prime Power is available for a limited number of hours in a non-variable load application. It is intended for use in situations were prime Power to exceed the Prime Power in a prime Power is available for a limited number of hours in a non-variable load application. It is intended for use in situations were prime Power to exceed the Prime Power rating. The customer should be aware, however, that the life of any engine will be reduced by this constant high

### Data Subject to Change Without Notice

Reference AEB 10.47 for determining Electrical Output.


Data shown above represent gross engine performance capabilities obtained and corrected in accordance with ISO-3046 conditions of 100 kPa (26.53 in Hg) barmentic pressure [110 m (361 tj bltude]. 25 °C (77 °F) air inlet temperature, and relative humidity of 30% with No. 2 diesel or corresponding to ASTM D2. Derates shown are based on 15 in H20 air intake restriction and 2 in Hg exhaust back pressure.

The fuel consumption data is based on No. 2 diesel fuel weight at 0.85 kg/litre (7.1 lbs/U.S. gal). Power output curves are based on the engine operating with fuel system, water pump and lubricating oil pump; not included are battery charging alternator, fan, optional equipment and driven components.

Data Status: Final-(Measured data)

Data Tolerance: +/- 5 %

**CHIEF ENGINEER: Cary J Marston** 

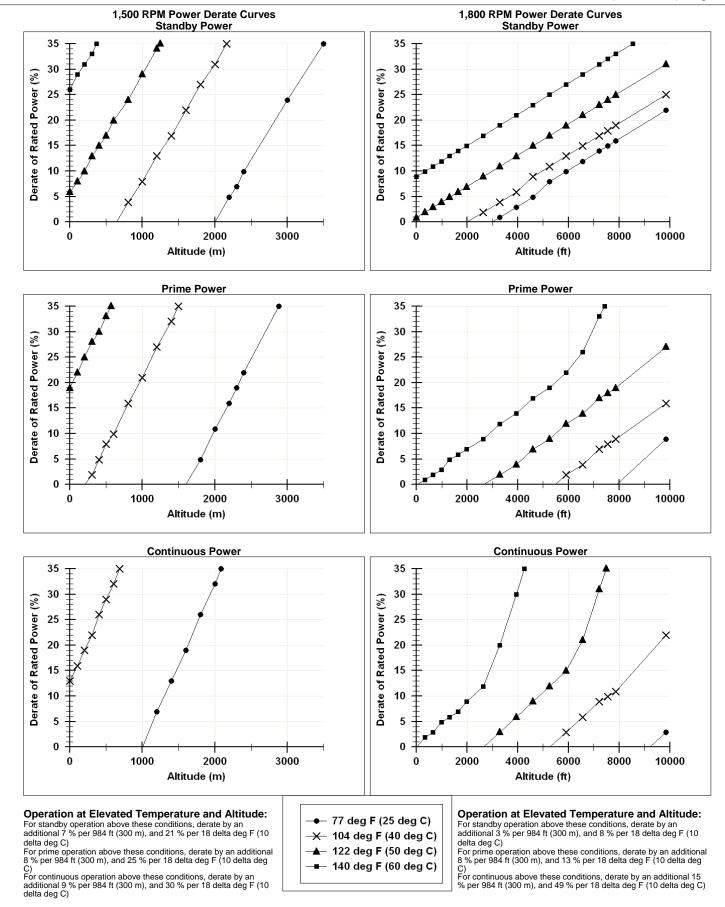

General Engine Data				
Туре			cle; Vee; 12 Cy	
Aspiration Pers y Stroke	6.25 x 6.25		arged and After	
Bore x Stroke			159 x 159 37.7	
Displacement	2,301	III3	_	L
Compression Ratio Approximate engine weight (wet)	9,039	lhm	15:1 4,100	ka
	9,039	IDIII	4,100	ĸy
Moment of Inertia of Rotating Components	00	'- II-( ++0	40.4	1 ++
with FW6074 Flywheel		in-lbf-sec**2		kg-m**
with FW6077 Flywheel	184	in-lbf-sec**2	20.8	kg-m**
Center of Gravity				
from rear face of block	31.54	in	801	mm
above crankshaft centerline	6.8		173	mm
Maximum Static Loading at Rear Main Bearing	2,000	lbm	907	kg
Engine Mounting				
Maximum Bending Moment at Rear Face of Block	4,500	lb-ft	6,101	N-m
Exhaust System				
Maximum back pressure at Standby Power	2	in-Hg	7	kPa
Air Induction System				
Maximum Intake Air Restriction				
with Dirty Filter Element	25	in H2O	6.2	kPa
with Normal Duty Air Cleaner and Clean Filter Element	15	in H2O	3.7	kPa
Cooling System				
Coolant Capacity				
Engine	112	quarts	106	L
Aftercoolers		quarts	22.7	ı
Minimum pressure cap rating at sea level		psi		kPa
Maximum static head of coolant above crankshaft centerline	60	•	18.3	
Jacket Water Circuit Permirements				
Jacket Water Circuit Requirements  Maximum Coolant Friction Head Futurnal to Engine 4 500/4 800 RRM	10 / 10	no:	60.0 / 60.0	I <sub>2</sub> Do
Maximum Coolant Friction Head External to Engine - 1,500/1,800 RPM	10 / 10		68.9 / 68.9	
Maximum Coolant Temperature (Max Top Tank Temp) for standby/prime power	220 / 212	ū	104 / 100	•
Thermostat (Modulating) Range	180 - 202	deg F	82 - 94	deg C
Aftercooler Circuit Requirements				
Maximum Coolant Friction Head External to Engine - 1,500/1,800 RPM	10 / 10	psi	68.9 / 68.9	kPa
Maximum coolant temperature into the aftercooler @ 25C (77F) ambient	120	deg F	49	deg C
Maximum coolant temperature into aftercooler @ Limiting Ambient conditions for		Ü		Ü
standby/prime power	170 / 160	deg F	77 / 71	deg C
Thermostat (Modulating) Range	115 - 135		46 - 57	_
_ubrication System				
Oil Pressure				
@ Minimum low idle	20	psi	138	kPa
@ Governed speed	50 - 70	•	344.7 - 482.0	
Maximum Oil Temperature		deg F		deg C
Oil Capacity with OP Oil Pan: Low-High		Ū		ueg C
Oil Capacity with OP Oil Pan: Low-High	37 - 44	gal	140.1 - 166.6	1
Total System Capacity (with Combo Filter)	45	gal	170.3	
Fuel System				
Type Injection System		C.	ummins MCRS	
		Cl	CAOIN CITITUE	
Maximum fuel supply restriction at fuel pump inlet	_		40.5	
with clean fuel filter element(s) at maximum fuel flow		in-Hg	16.9	
with dirty fuel filter element(s) at maximum fuel flow		in-Hg		kPa
Maximum fuel inlet temperature	160	deg F	71	deg C
Maximum supply fuel flow	185	gal/hr	700	L/hr

99.6 / 102.2 dBa

**Electrical System** 

System voltage <u>24 V</u>

Minimum Recommended Battery Capacity

cold soak at 10 deg C (50 deg F) and above cold soak at 0 to 10 deg C (32 to 50 deg F) cold soak at -18 to 0 deg C (0 to 32 deg F)

1,800 CCA Maximum starting circuit resistance 0.002 Ohm

### Cold start capability

**Unaided Cold Start** 

Minimum cranking speed 150 RPM 45 deg F 7.2 deg C

Minimum ambient temperature for unaided cold start

**Performance Data** All data is based on:

· Engine operating with fuel system, water pump, lubricating oil pump, air cleaner and exhaust silencer; not included are battery charging alternator, fan, and optional driven components.

Engine operating with fuel corresponding to grade No. 2-D per ASTM D975.

ISO 3046, Part 1, Standard Reference Conditions of:

Barometric Pressure: 100 kPa (29.53 in Hg) Air Temperature: 25 °C (77 °F)

Altitude: 110 m (361 ft) Relative Humidity: 30%

Estimated Free Field Sound Pressure Level of a Typical Generator Set;

Excludes Exhaust Noise; at Rated Load and 7.5 m (24.6 ft);

1,500/1,800 RPM

Exhaust Noise at Rated 1 m Horizontally From Centerline of Exhaust Pipe Outlet Upwards at 45%; 1,500/1,800 RPM 96.9 / 95.6 dBa

	RPM	Standby Power		Prime Power		
Governed Engine Speed		1,800	1,500	1,800	1,500	
Engine Idle Speed	RPM	700 - 900	700 - 900	700 - 900	700 - 900	
Gross Engine Power Output Brake Mean Effective Pressure	hp (kW) psi (kPa)	1,716 (1,280) 327 (2,255)	1,641 (1,224) 375 (2,586)	1,425 (1,063) 272 (1,875)	1,484 (1,107) 339 (2,337)	
Piston Speed	ft/min (m/s)	1,870 (9.5)	1,555 (7.9)	1,870 (9.5)	1,555 (7.9)	
Friction Horsepower	hp (kW)	163 (122)	115 (86)	163 (122)	115 (86)	
Engine Jacket Water Flow at Stated Fexternal to Engine	Friction Head					
- 2.5 psi-2.5 psi Friction Head	gpm (L/min)	336 (1,272)	274 (1,037)	336 (1,272)	274 (1,037)	
- Maximum Friction Head	gpm (L/min)	284 (1,075)	209 (791)	284 (1,075)	209 (791)	
Engine Data						
Intake Air Flow	ft3/min (L/s)	4,321 (2,039)	3,380 (1,595)	3,894 (1,838)	3,229 (1,524)	
Exhaust Gas Temp - Dry Stack	deg F (deg C)	748 (398)	907 (486)	708 (376)	901 (483)	
Exhaust Gas Flow	ft3/min (L/s)	9,307 (4,392)	8,289 (3,912)	8,202 (3,871)	7,926 (3,741)	
Air to Fuel ratio		31.6:1	26:1	33.9:1	27:1	
Heat Rejection to Ambient	BTU/min (kW)	7,150 (126)	6,810 (120)	6,020 (106)	6,265 (110)	
Heat Rejection to Jacket Coolant	BTU/min (kW)	25,783 (453)	25,381 (446)	21,804 (383)	23,893 (420)	
Heat Rejection to Exhaust	BTU/min (kW)	48,545 (854)	50,119 (881)	42,445 (746)	46,851 (824)	
Heat Rejection to Fuel*	BTU/min (kW)	414 (7.3)	379 (6.7)	414 (7.3)	379 (6.7)	
2P2L						
Heat Rejection to Aftercooler Coolant	t BTU/min (kW)	24,467 (430)	18,186 (320)	19,509 (343)	16,461 (289)	
Aftercooler Water Flow at Stated Fric	` '	, - ( ,		1,222 (2.2)		
external to Engine						
- 2.5 psi-2.5 psi Friction Head	gpm (L/min)	168 (636)	137 (519)	168 (636)	137 (519)	
- Maximum Friction Head	gpm (L/min)	150 (568)	116 (439)	150 (568)	116 (439)	

<sup>\*</sup>This is the maxiumum heat rejection, not specified to the load listed

**End of Report**